



Board of Adjustment **Notification Plan for** **Case No A-19-10300115**





San Antonio City Limits
 Subject Property
 200' Notification Boundary
 Council District: 4



1:1,200

"NOT TO SCALE,
 FOR ILLUSTRATIVE PURPOSES ONLY"

Development Services Department
 City of San Antonio

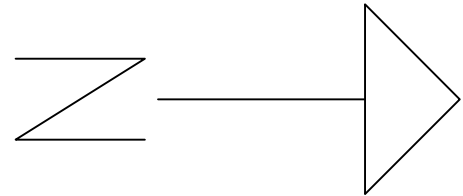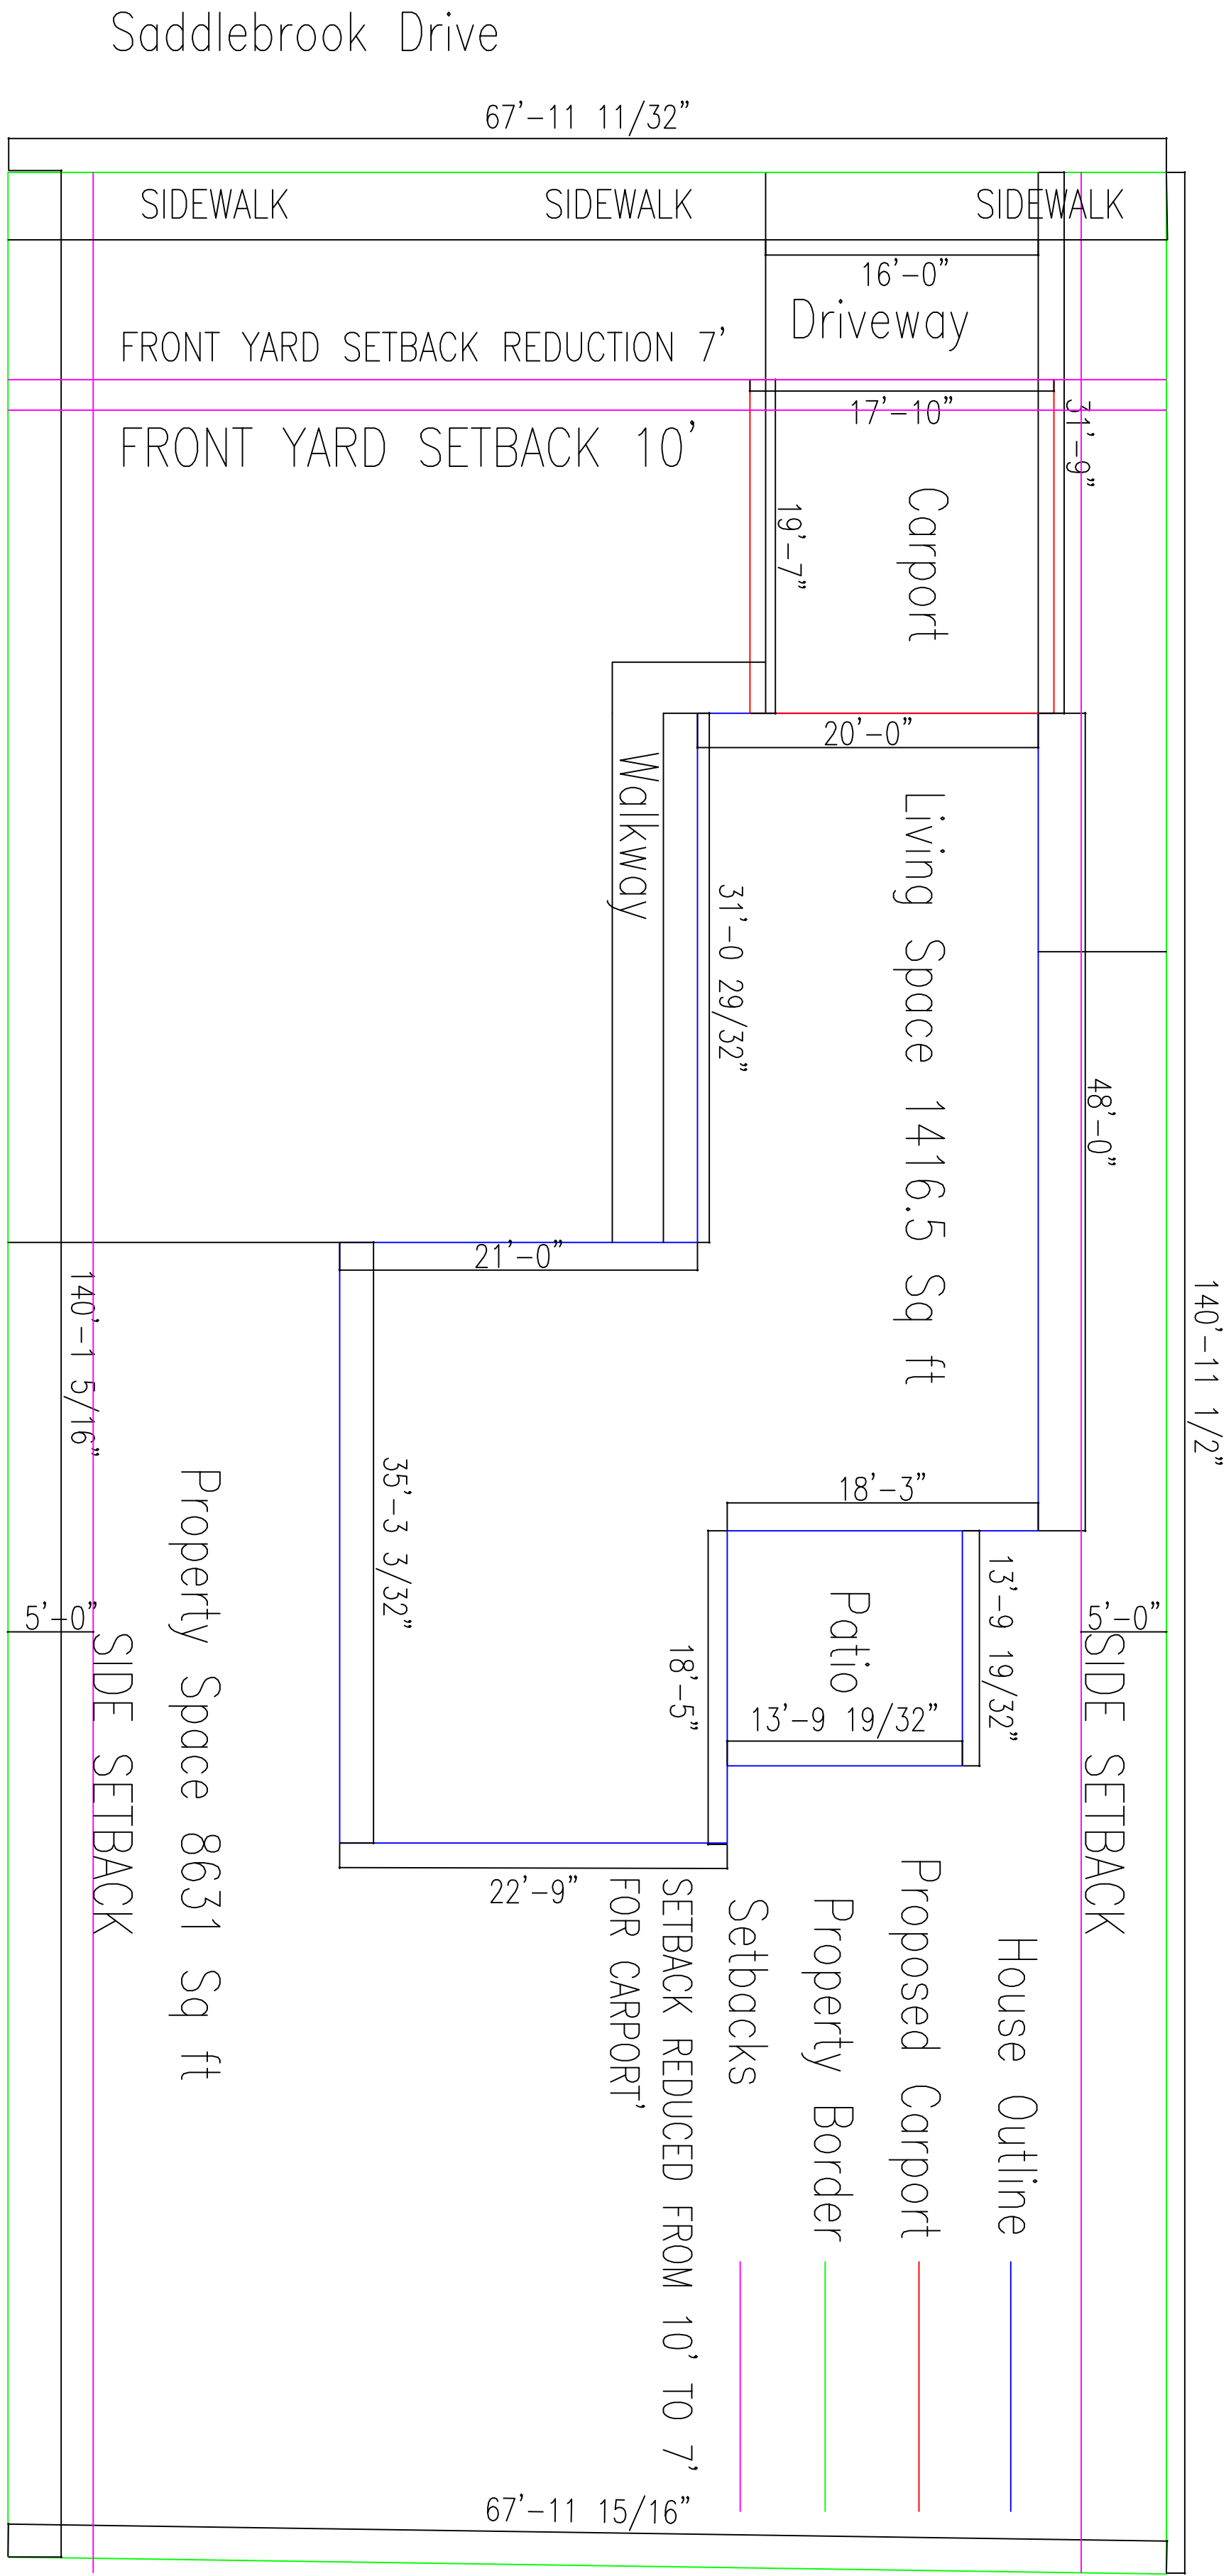

- GENERAL INSTALLATION NOTES:
- ALL WIRES AT FIP MUST BE IDENTIFIED AND TAGGED FOR PROPER TERMINATION.
 - ALL WIRING SHALL BE A MINIMUM OF 18 AWG.
 - ALL WIRES SHALL TEST FREE OF SHORTS AND GROUNDING.
 - WIRING OF THE MAGNETIC LOCK TO THE COARSE DEVICE SHALL CONSIST OF BREAKING LOCK POWER AS WELL AS REQUESTING EXIT FROM ACCESS CONTROL EQUIPMENT.
 - BATTERY BACKUP WILL BE PROVIDED TO ACCOMMODATE 4 HOURS OF OPERATION WITHOUT PRIMARY POWER.
 - INSTALLATION SHALL BE PER NEC ARTICLE 760, 761, 72 AND OTHER RELEVANT STANDARDS.
 - CARD READERS AND COARSE BUTTONS SHALL BE MOUNTED BETWEEN 42" AND 54" AFF.
 - CARD READER WIRING SHALL BE STRAPPED, SHIELDED & CONDUCTOR. SHIELD SHALL BE CONNECTED TO PANEL GROUNDING.

GARCIA RESIDENCE
232 SADDLEBROOK DRIVE
SAN ANTONIO, TEXAS
CARPORT PROPOSAL

LTR	Description	DATE
		09/06/19

Job Number: xxxxxxxx

Approved By: JMK

Occupancy: JMK

Scale: 1/8" = 1'-0"

Revised To: xxx

Size: 11x17 sheet

1 OF 1

Carport Proposal
SCALE: 1/8" = 1'-0"

BOA-19-10300115
Subject Property – 232 Saddlebrook Dr



Subject Property



Subject Property



Subject Property



Subject Property



Neighboring Properties



Neighboring Properties



Neighboring Properties



Neighboring Properties



Street view - Saddlebrook Dr.

